
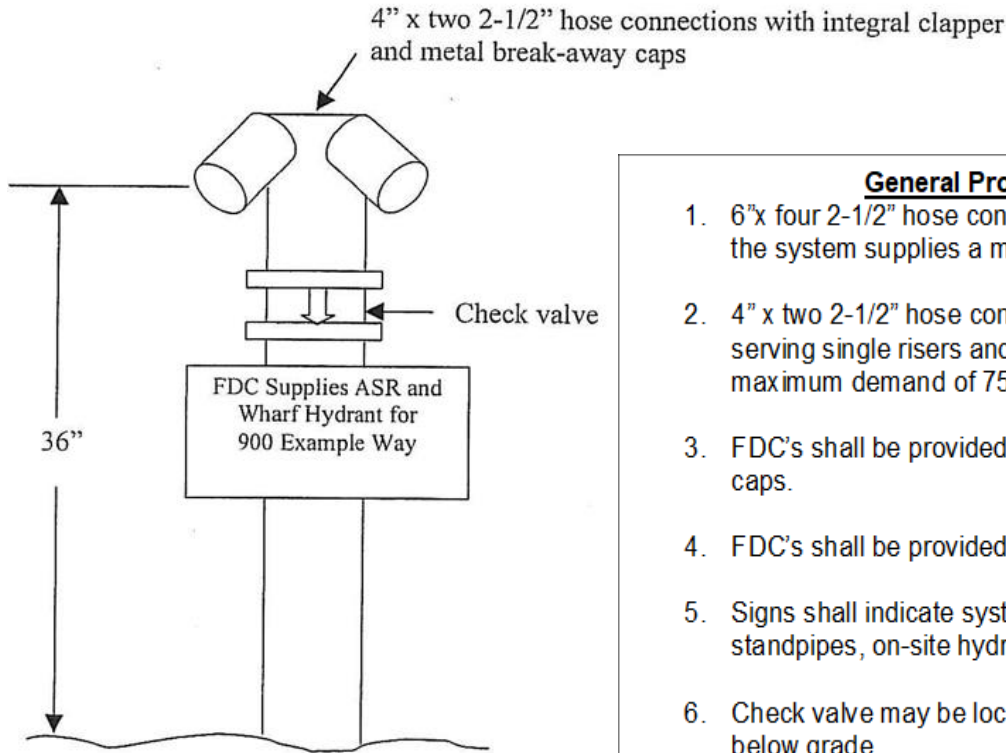


SIGN EXAMPLES

FIRE DEPARTMENT CONNECTION DETAILS (Not to scale)

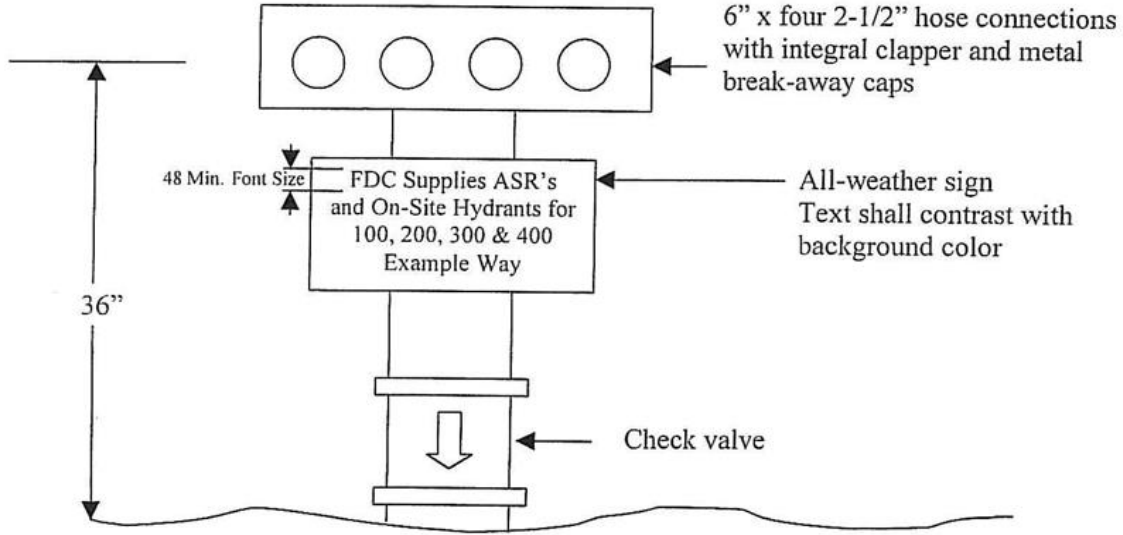

General Provisions

1. 6" x four 2-1/2" hose connections are required when the system supplies a minimum 6" UG supply.
2. 4" x two 2-1/2" hose connections are adequate for serving single risers and wharf hydrants with a maximum demand of 750 gpm.
3. FDC's shall be provided with metal break-away caps.
4. FDC's shall be provided with all-weather signs.
5. Signs shall indicate systems served (i.e. ASR's, standpipes, on-site hydrants, wharf hydrants.)
6. Check valve may be located in approved vault below grade.