


ON-SITE WHARF HYDRANT SPECIFICATIONS

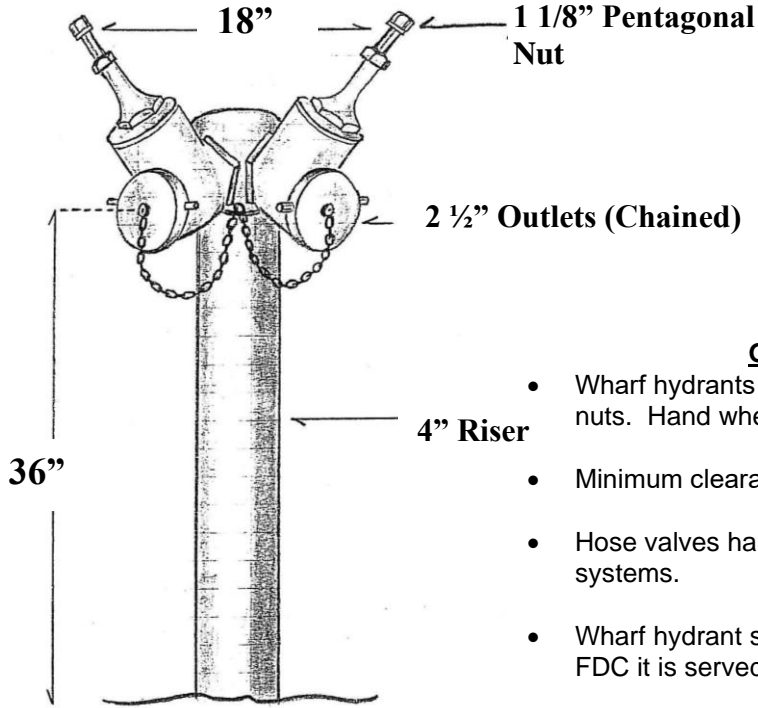

General Provisions

- Wharf hydrants shall be provided with 1 1/8" pentagonal nuts. Hand wheels are not acceptable.
- Minimum clearance between operating nuts is 18"
- Hose valves shall be listed for exterior use in wet-pipe systems.
- Wharf hydrant shall be provided with sign indicating which FDC it is served by.

SIGN EXAMPLES

PIV Controls ASR,
Standpipe and
On-Site Hydrant for
2000 Example Way

48 Minimum
Font Size

FDC Supplies ASR's
and Wharf Hydrants
for 100, 110 and 120
Sample Street

General Provisions

- Text shall content with background color.
- Each PIV FDC and wharf hydrant shall have a sign. For example, additional signs would be required for the site PIV for each riser at 100, 110 and 120 Sample Street.

Wharf Hydrant
Supplied by FDC on:
2000 Example Way

Text shall contrast with background color.

Each PIV and FDC shall have a sign. For example, additional signs would be required for the site PIV and the PIV for each riser at 100, 110 and 120 Sample Street.